

RFI 34

Project: COOLEY LABORATORY RENOVATION  
Job: 3146 COOLEY LAB, PPA# 10-0023  
Customer: STOFMT MSU BOZEMAN  
Issued To: CONSTRUCTION MANAGEMENT SERV.  
P.O. BOX 7274  
BOZEMAN, MT 59715

POTENTIAL IMPACTS

Cost Impact: No  
Schedule Impact: No

Attention: DONALD J. PLATISHA  
Phone/Fax: 406 585-0611 / 406 585-2698

Coordination copies to:

Item: Industrial Waste Routing Second Floor Type: MECH  
Reference: M2.2.1 Spec. Section:  
Attachments: 1 drawing

**Description of Request**

**QUESTION:**

On print M2.2.1 in the corridor south side at grid line 4 the prints show a 2" IW line running down to 1st floor. This cannot be run there as there is a beam directly under that area. (See Attached Drawing)

**RECOMMENDATION:**

Run the waste line to the west across the hall to the north and west and join the waste line in the corridor. Run the waste line to the east across the hall slightly to the west to join another IW line running down. (See Attached Drawing)

Williams Plumbing


Respond By: By:

**Response**

The proposed rerouting is acceptable and will likely save materials.

Signed: Dave Broquist Date: 10-10-11

Proceed as Indicated: \_\_\_\_\_ Date: \_\_\_\_\_

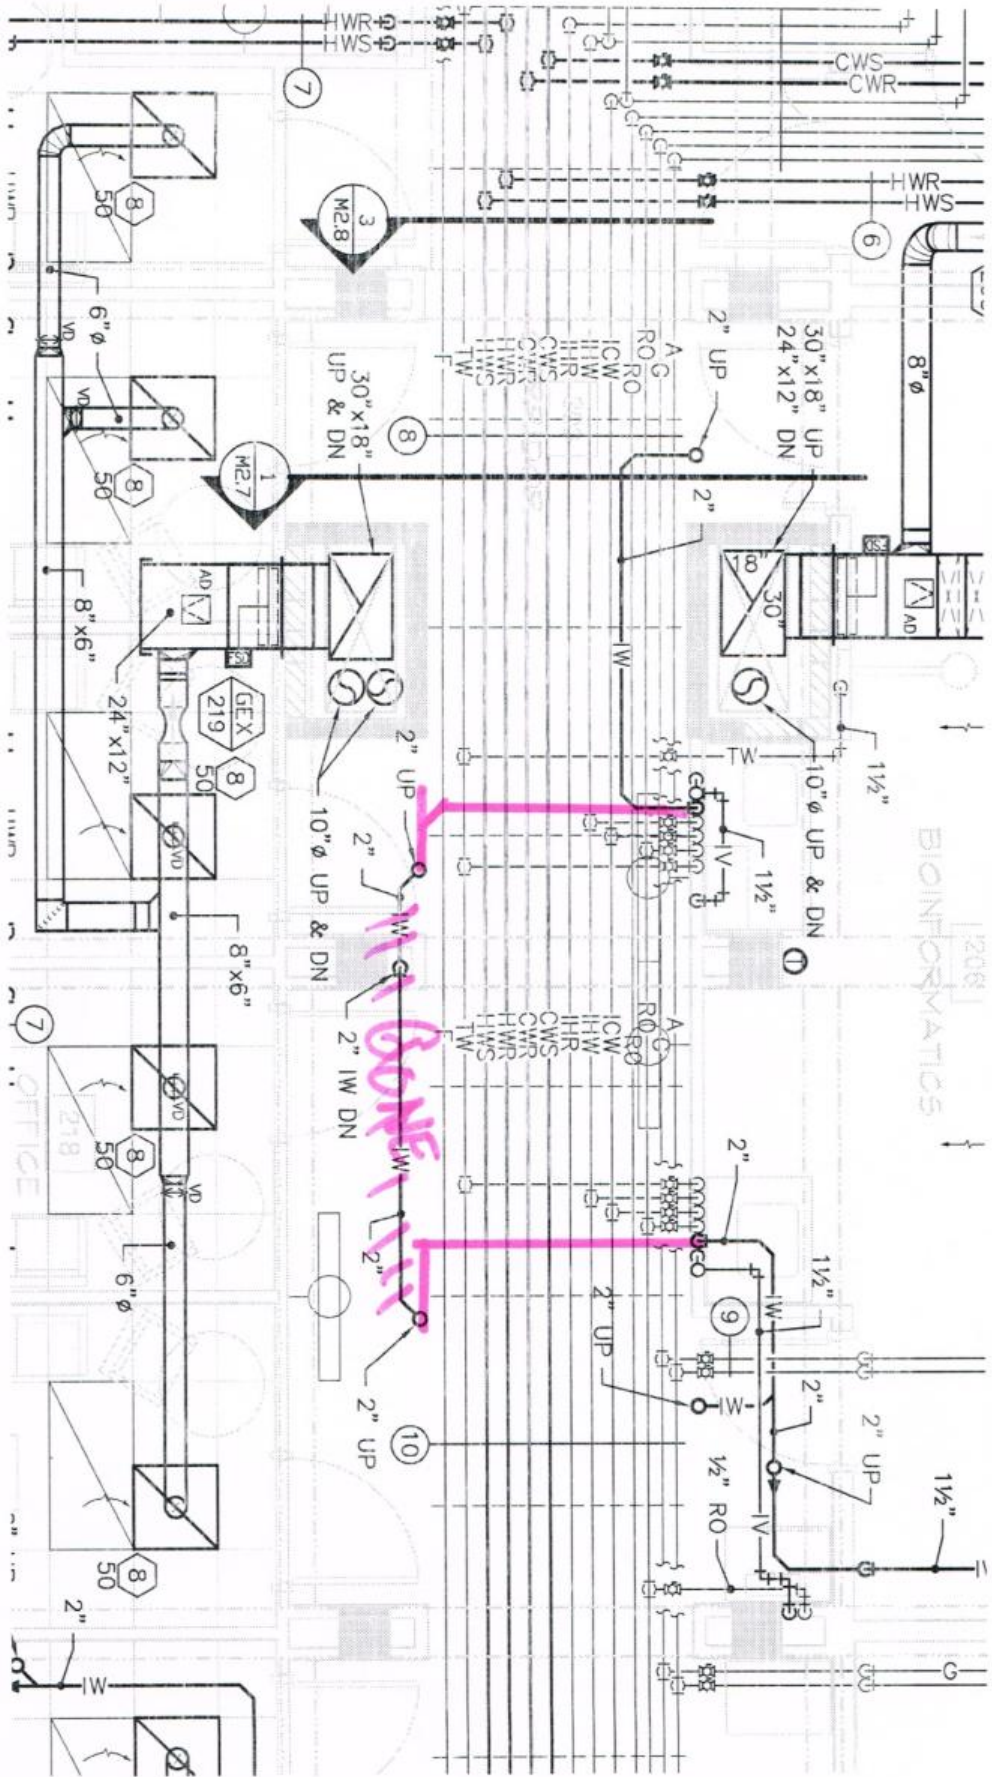

PFI  
 WPH  
 Oda