

REQUEST FOR PROPOSAL

Project Title: Cooley Laboratory Renovation
Location: Montana State University

PPA No.: 10-0023
RFP No.: 21
Date: 12/21/11

To: Dick Anderson Construction
4498 Jackrabbit Lane
Bozeman, MT 59718

Attention: Platisha

From: Cecilia Vaniman, Project Manager
Cooley Lab Renovation
Montana State University

Attention: _____

In order to expedite the Work and avoid or minimize delays in the Work the following proposal is requested. Please return a response by: 12/30/11 Date Sent: 12/21/11
Date Received: _____

RFP DELETE VAC(VACUUM) Fittings & Piping

Reference Drawings: QL3.1 DETAIL 2 & DETAIL 4

Also QL4.1 DETAIL 6


Reference Specifications: 11604.2.1.M

Remove All service fittings noted as **VAC** fitting and piping associated with the Mobile Bench Casework and Ceiling Service Panel @ 31 locations .

Attachment: Detail 4 QL3.1

This RFP is for pricing purposes only. The contractor shall not proceed with the scope of work described within until pricing is approved by the owner in writing.

Distribution: Owner Architect Engineer
 Agency Contractor Other

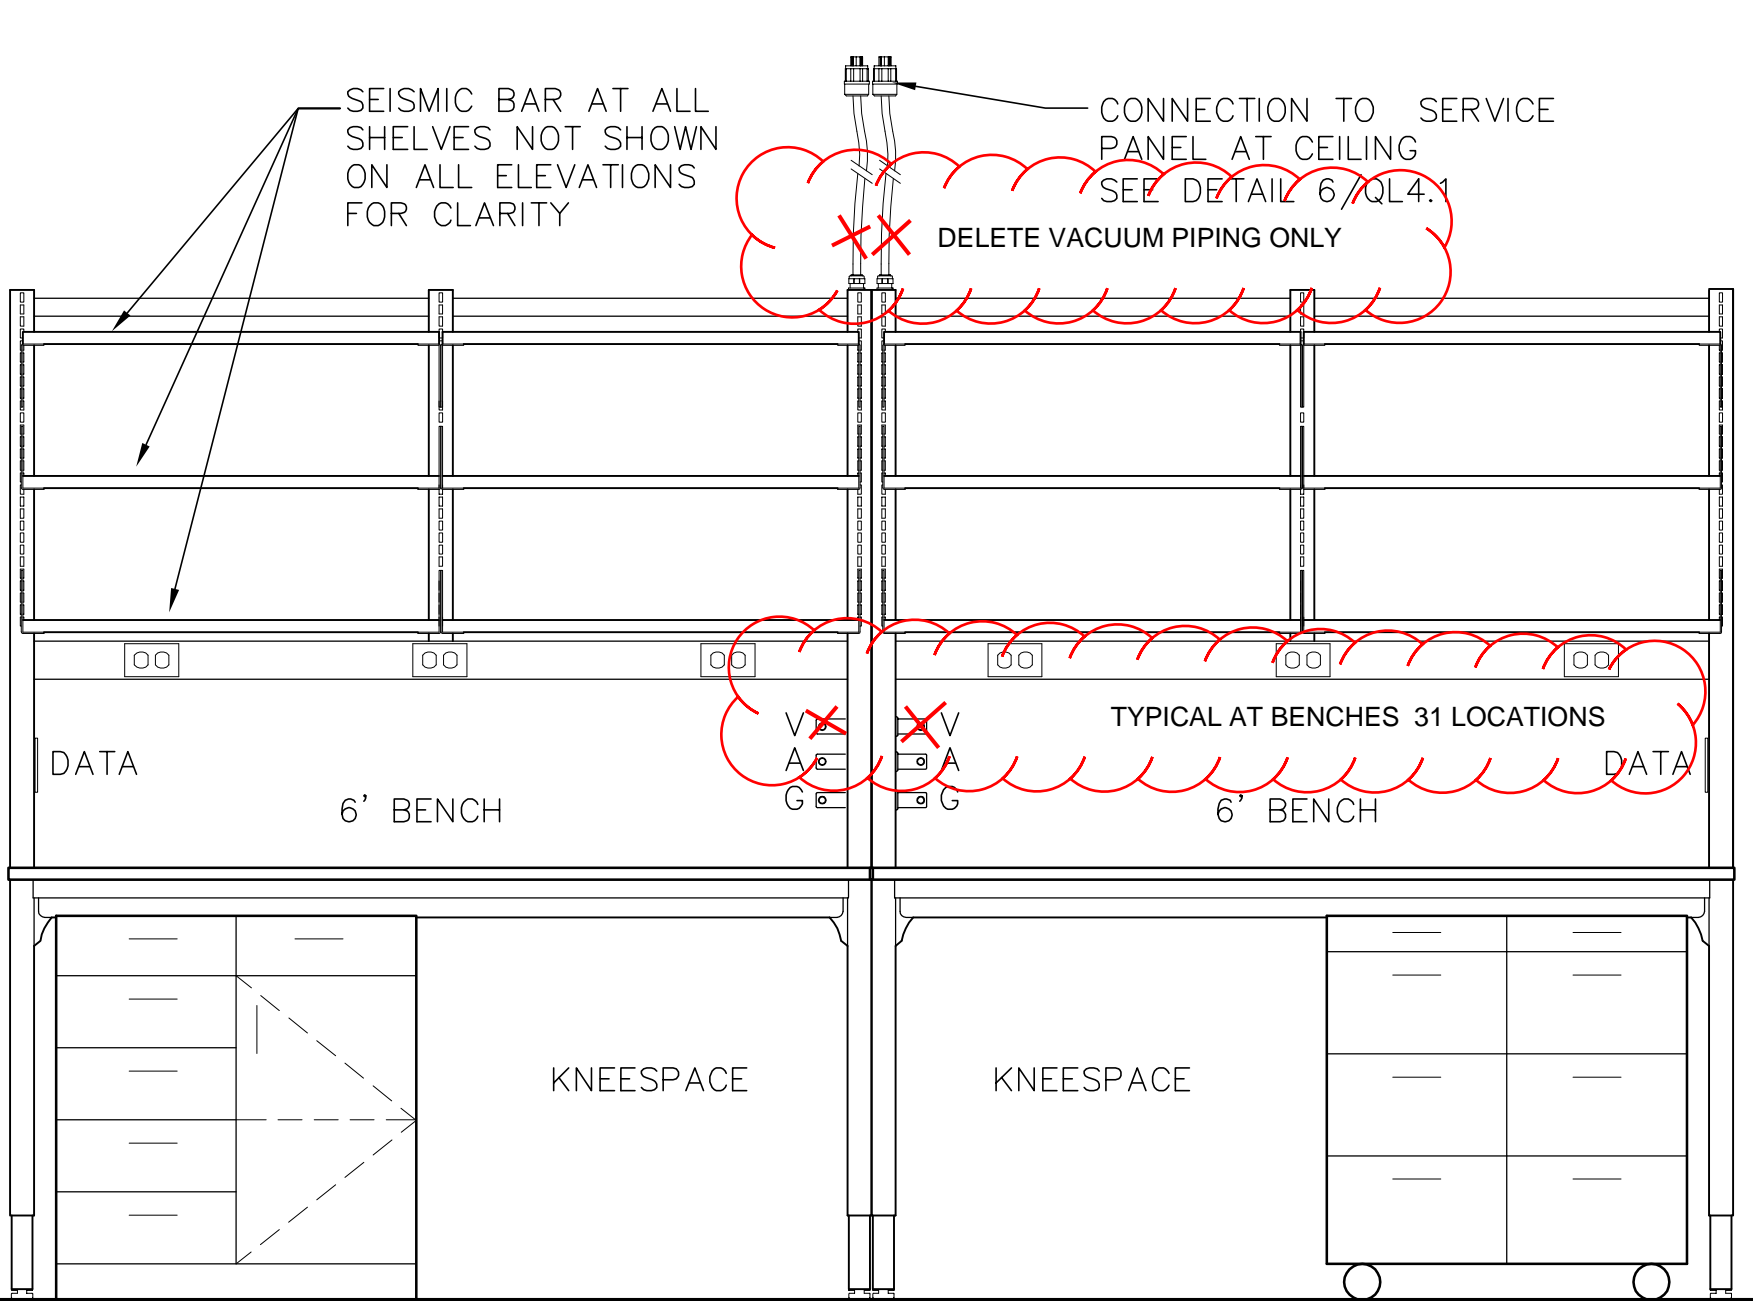

B TYPE CABINET
RELOCATABLE

A TYPE CABINET
ON CASTERS

NOTE: VAC (V) AND AIR (A) ARE NOT PART OF THE "HOUSE" SERVICES;
THE VALVE ARE ONLY PART OF THE CASEWORK SYSTEM.

4

MOBILE BENCH ELEVATION

3/4" = 1'-0"